



PLAN

TEES

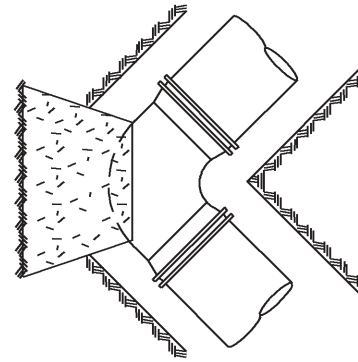


PLAN

BENDS

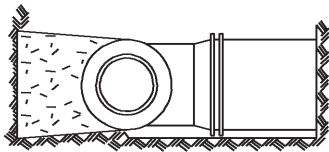

PROFILE

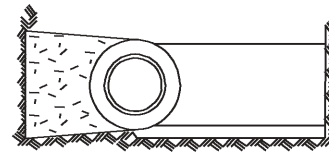

PROFILE

ALL THRUST BLOCKING SHALL BE SOLID CONCRETE BLOCKS 6"x8"x16" IN SIZE. ALL FITTINGS UP TO 12" IN SIZE SHALL HAVE MIN.DIMENSIONS OF 8"x6" AT THE POINT OF CONTACT WITH UNDISTURBED EARTH. ADDITIONAL THREADED RODS AND RETAINER GLANDS SHALL BE USED IF THE SITUATION REQUIRES THESE. Poured thrust blocking must be approved by the WATER RESOURCES DIVISION.

STANDARD DETAIL
FOR
WATER MAIN THRUST BLOCKING

REVISIONS
RBR 1/15/04

CITY OF DEKALB
WATER MAIN
STANDARD
WM-301